



SIDE VIEW

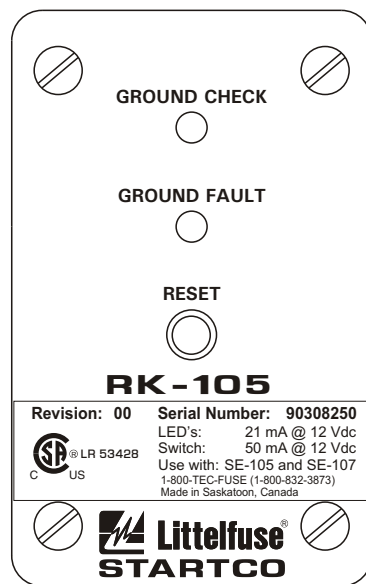

FRONT VIEW

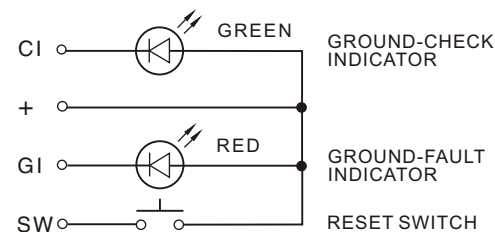

INTERNAL SCHEMATIC


NOTES:

1. TERMINAL MARKINGS CORRESPOND ON TERMINAL MARKINGS ON THE SE-105/SE-107.
2. SEE SE-105 OR SE-107 MANUAL FOR MORE INFORMATION.
3. MANUALS ARE AVAILABLE AT www.startco.ca

RK-105

REMOTE INDICATION-AND-RESET ASSEMBLY FOR SE-105/SE-107
MOUNTING SCREWS, LOCKNUTS AND
DRILLING TEMPLATE ARE INCLUDED.

LED'S: 21 mA @ 12 Vdc
RESET SWITCH: 50 mA @ 12 Vdc

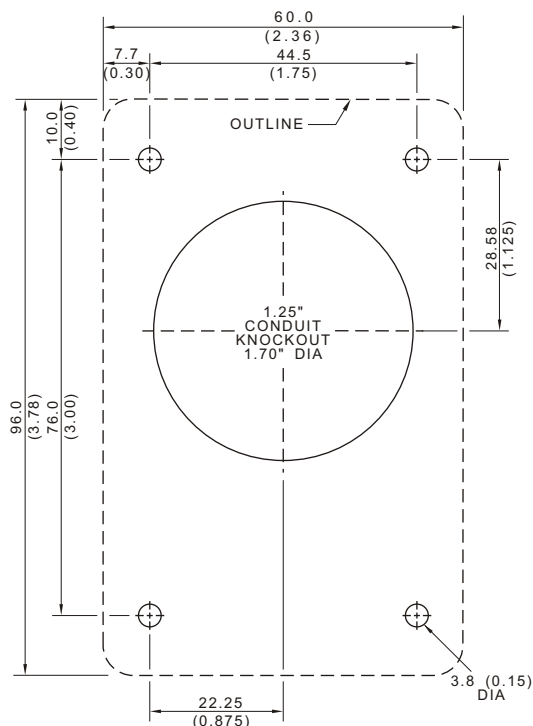

MOUNTING DETAIL

NOTES:

1. DIMENSIONS IN MILLIMETRES (INCHES).
2. NEMA 1.



Littelfuse
STARTCO
1-800-TEC-FUSE (1-800-832-3873)
Made in Saskatoon, Canada



Ground Fault Sensing
and Relaying Equipment
4FX9 E340889

Copyright © 2011
Printed in Canada
181011